FIRE PLAN

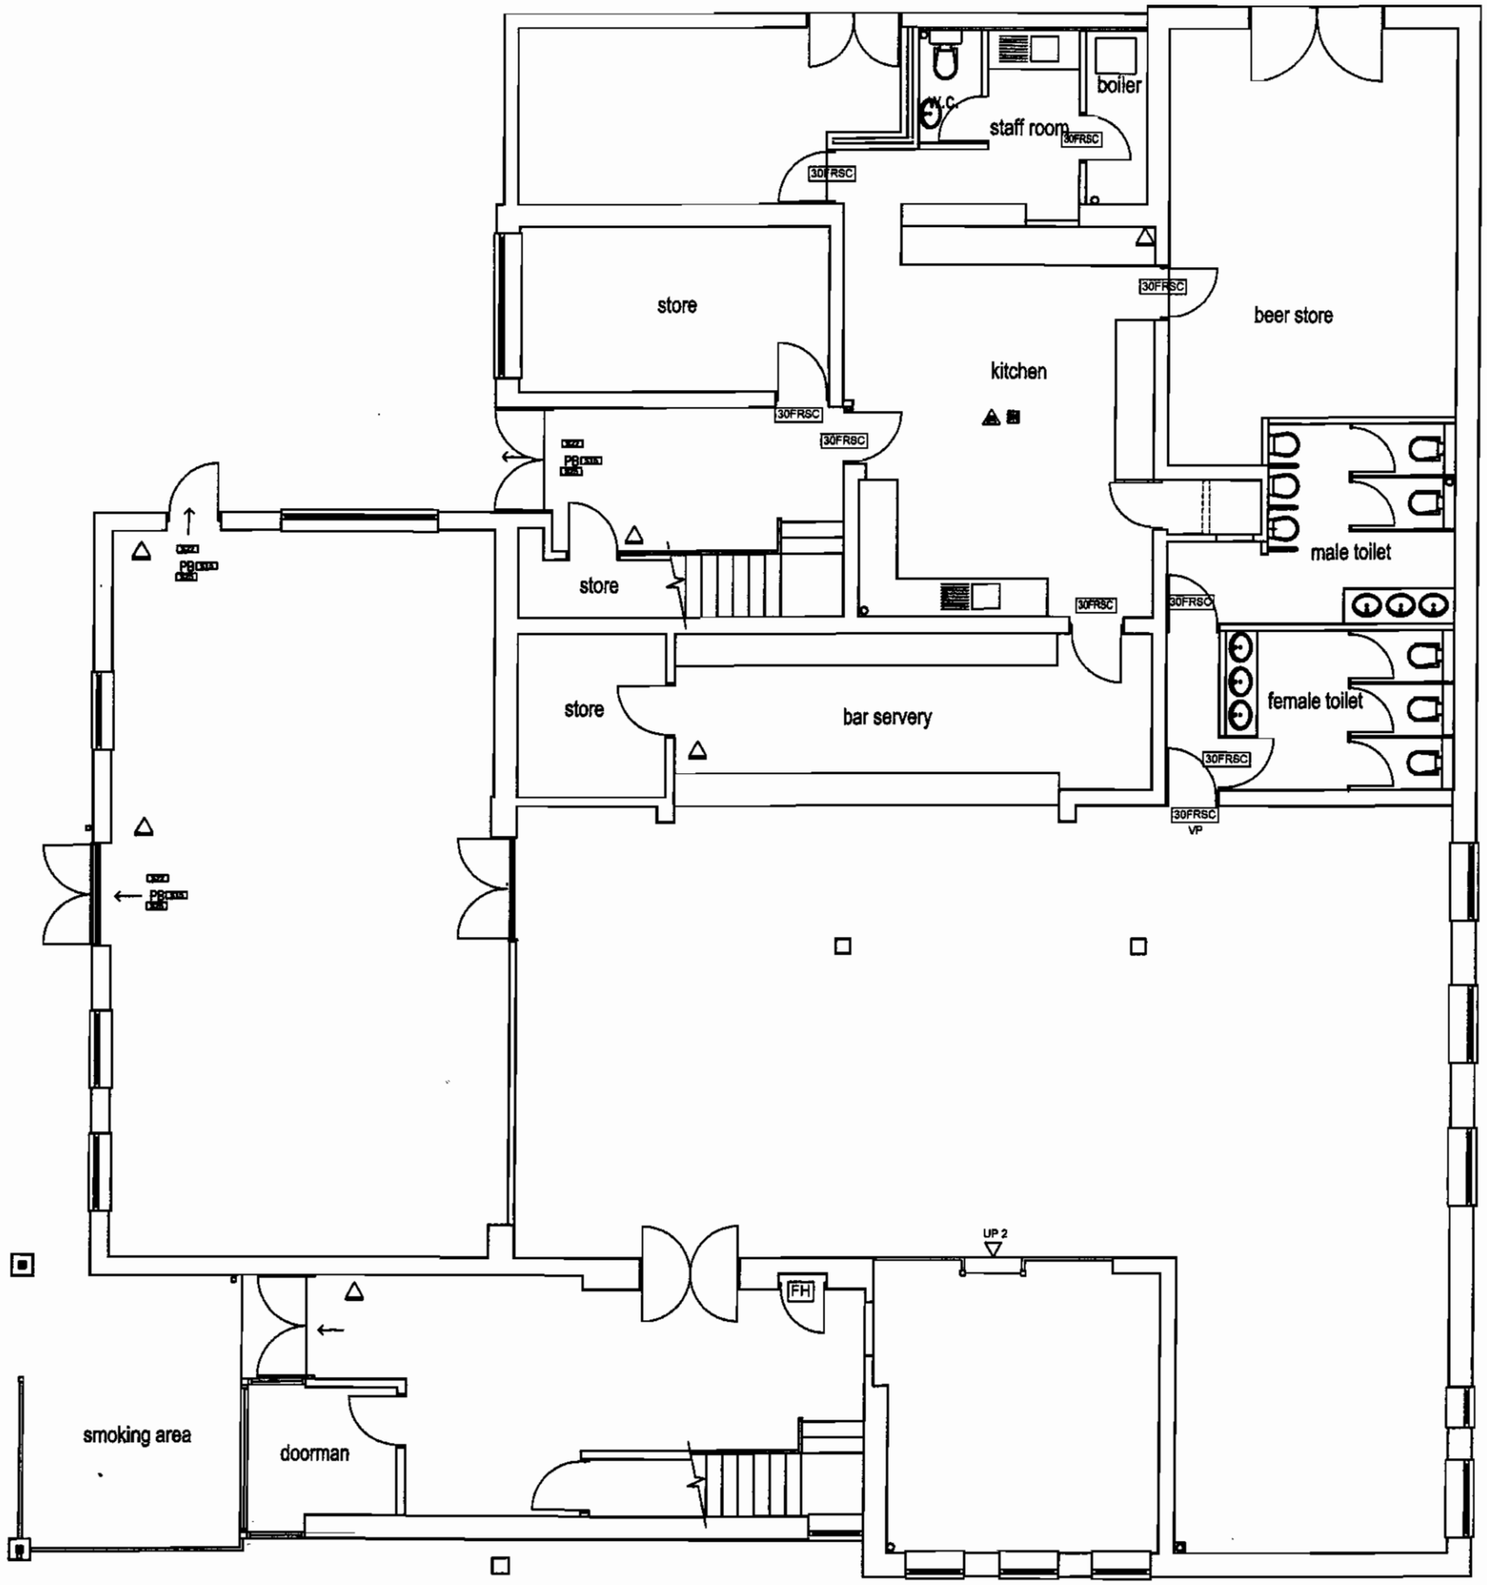

FIRE SIGNAGE TO COMPLY WITH BS 1635 AND BS5499

FIRE EXTINGUISHING INSTALLATIONS AND EQUIPMENT TO COMPLY WITH BS5306

EMERGENCY LIGHTING TO COMPLY WITH BS5266

PB	PUSH BAR IRONMONGERY
	FIRE EXTINGUISHER WATER TYPE
	FIRE EXTINGUISHER FOAM TYPE
	FIRE EXTINGUISHER DRY POWDER
	FIRE EXTINGUISHER CARBON DIOXIDE GAS
	FIRE EXTINGUISHER ANY TYPE WALL MOUNTED
	FIRE EXTINGUISHER FIRE BLANKET
S	FIXED ALARM DEVICE SMOKE DETECTOR
	FIXED ALARM DEVICE FIRE ALARM CALL POINT MANUAL
	FIXED ALARM DEVICE WARNING DEVICE BELL
	FIXED ALARM DEVICE WARNING DEVICE SOUNDER
	FIXED ALARM DEVICE WARNING DEVICE VISUAL
	EMERGENCY LIGHTING SELF CONTAINED
	EMERGENCY LIGHTING MAINTAINED
	EMERGENCY LIGHTING EXIT SIGN ILLUMINATED INTERNALLY
	FIRE SAFETY SIGN FIRE ACTION SIGNS
	FIRE SAFETY SIGN FIRE DOOR KEEP SHUT
	FIRE SAFETY SIGN FIRE DOOR KEEP LOCKED
	FIRE SAFETY SIGN AUTOMATIC FIRE DOOR KEEP CLEAR
	FIRE SAFETY SIGN DOOR TO BE UNLOCKED
	FIRE SAFETY SIGN DOOR KEEP CLEAR
	FIRE SAFETY SIGN FIRE EXIT
	SLIDE TO OPEN
	FIRE SAFETY SIGN PUSH BAR TO OPEN
←	FINAL ESCAPE

FIRE ALARM TO BS 5839

NOTE MUSIC SYSTEM MAINS SUPPLY TO BE CONNECTED TO ALARM SYSTEM TO CUT OFF WHEN ALARM ACTIVATED

EMERGENCY LIGHTING TO BS 5266 TO FIRST FLOOR SIGNAGE TO BS 5499

30FRSC 30 MIN.FIRE RESISTING DOOR WITH SELF CLOSER

30FRSC VP 30 MIN.FIRE RESISTING DOOR WITH SELF CLOSER & VISION PANEL GLAZED WITH FR GLASS

FIRE EXTINGUISHING INSTALLATIONS AND EQUIPMENT TO COMPLY WITH BS5306

NOTE - ALL FIRE RESISTING DOORS TO BE FITTED WITH SMOKE SEALS AND INTUMESCENT STRIPS

FH FIRE ~~HYDRANT~~ HOSE

DEVELOPMENT CONTROL SECTION

12 MAR 2009

Referred to

SUPERSEDED

Rev	Date	Description
Issued for : DISCUSSION		

Client-Scheme

Mr. H. Gosal
PROPOSED REDEVELOPMENT OF FORMER ASHBY & DISTRICT WORKING MENS CLUB
ASHBY HIGH STREET SCUNTHORPE
NORTH LINCOLNSHIRE

Drawing Title

Proposed Ground Floor Plan

Shepherd Technical Services
110 Bushfield Road
Scunthorpe
North Lincolnshire
DN16 1NA
Tel : 01724 330769
Fax: 01724 330768

SHEPHERD TECHNICAL SERVICES
Architectural, Civil & Structural Design Consultants

Date	JAN 09
Scale	1/50-A1 1/100-A3
Drawn	DS
Checked	

Drawing No.
2009/ A1 / HG / 105 rev A

FIRE PLAN

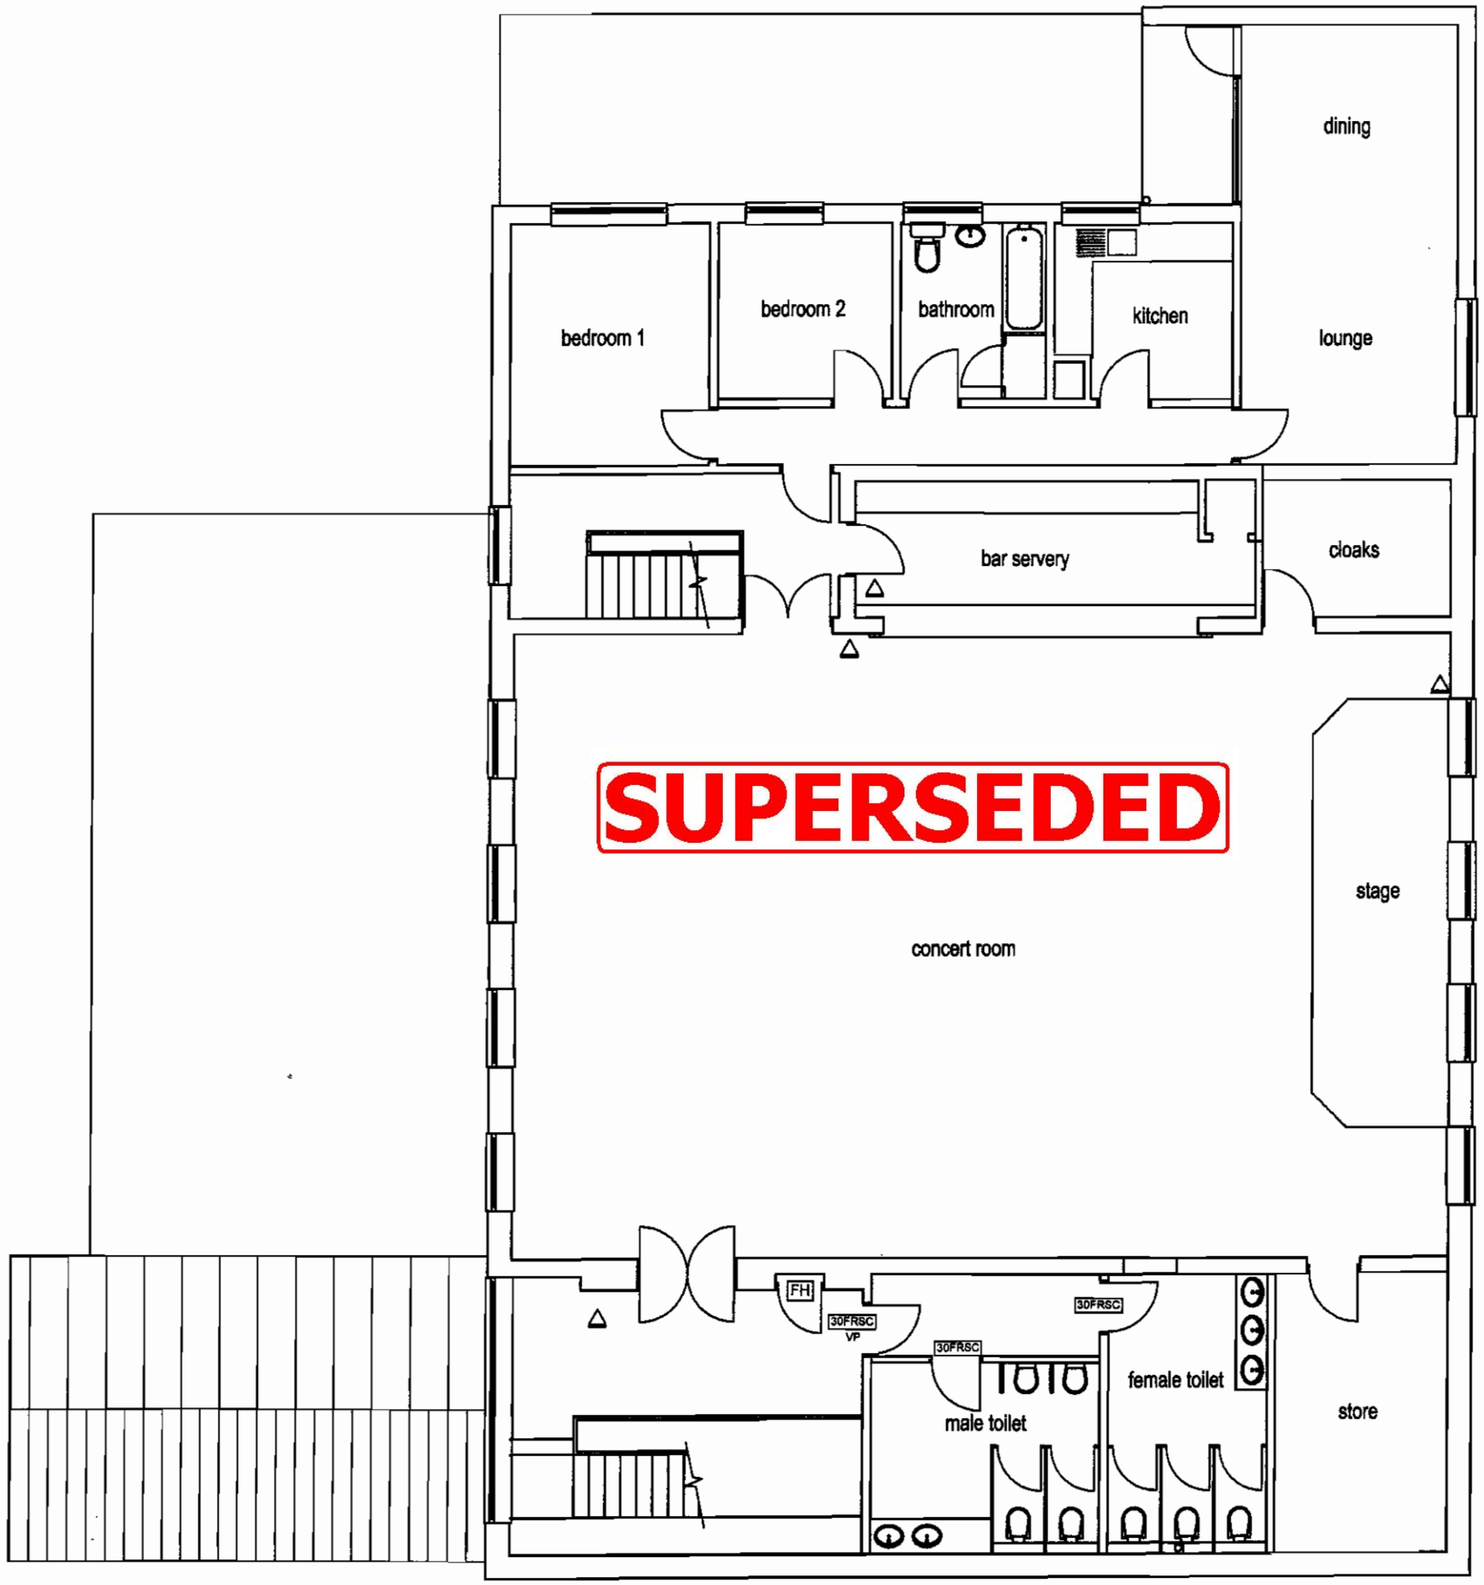

FIRE SIGNAGE TO COMPLY WITH BS 1635 AND BS5499

FIRE EXTINGUISHING INSTALLATIONS AND EQUIPMENT TO COMPLY WITH BS5306

EMERGENCY LIGHTING TO COMPLY WITH BS5266

PB	PUSH BAR IRONMONGERY		EMERGENCY LIGHTING SELF CONTAINED
	FIRE EXTINGUISHER WATER TYPE		EMERGENCY LIGHTING MAINTAINED
	FIRE EXTINGUISHER FOAM TYPE		EMERGENCY LIGHTING EXIT SIGN ILLUMINATED INTERNALLY
	FIRE EXTINGUISHER DRY POWDER		FIRE SAFETY SIGN FIRE ACTION SIGNS
	FIRE EXTINGUISHER CARBON DIOXIDE GAS		FIRE SAFETY SIGN FIRE DOOR KEEP SHUT
	FIRE EXTINGUISHER ANY TYPE WALL MOUNTED		FIRE SAFETY SIGN FIRE DOOR KEEP LOCKED
	FIRE EXTINGUISHER FIRE BLANKET		FIRE SAFETY SIGN AUTOMATIC FIRE DOOR KEEP CLEAR
S	FIXED ALARM DEVICE SMOKE DETECTOR		FIRE SAFETY SIGN DOOR TO BE UNLOCKED
	FIXED ALARM DEVICE FIRE ALARM CALL POINT MANUAL		FIRE SAFETY SIGN DOOR KEEP CLEAR
	FIXED ALARM DEVICE WARNING DEVICE BELL		FIRE SAFETY SIGN FIRE EXIT
	FIXED ALARM DEVICE WARNING DEVICE SOUNDER		SLIDE TO OPEN
	FIXED ALARM DEVICE WARNING DEVICE VISUAL		FIRE SAFETY SIGN PUSH BAR TO OPEN
		←	FINAL ESCAPE

FIRE ALARM TO BS 5839

NOTE MUSIC SYSTEM MAINS SUPPLY TO BE CONNECTED TO ALARM SYSTEM TO CUT OFF WHEN ALARM ACTIVATED

EMERGENCY LIGHTING TO BS 5266 TO FIRST FLOOR
SIGNAGE TO BS 5499

30FRSC 30 MIN.FIRE RESISTING DOOR WITH SELF CLOSER

30FRSC VP 30 MIN.FIRE RESISTING DOOR WITH SELF CLOSER & VISION PANEL GLAZED WITH FR GLASS

FIRE EXTINGUISHING INSTALLATIONS
AND EQUIPMENT TO COMPLY WITH BS5306

NOTE - ALL FIRE RESISTING DOORS TO BE FITTED WITH SMOKE SEALS AND INTUMESCENT STRIPS

FH FIRE ~~HYDRANT~~ HOSE

SECTION
12 MAR 2009
Referred to

Rev	Date	Description
A	03.01.09	Issued for Discussion

Issued for : DISCUSSION

Client-Scheme

Mr. H. Gosal
PROPOSED REDEVELOPMENT OF FORMER
ASHBY & DISTRICT WORKING MENS CLUB
ASHBY HIGH STREET SCUNTHORPE
NORTH LINCOLNSHIRE

Drawing Title

Proposed First Floor Plan

Shepherd Technical Services
110 Bushfield Road
Scunthorpe
North Lincolnshire
DN16 1NA
Tel : 01724 330769
Fax: 01724 330768

SHEPHERD TECHNICAL SERVICES
Architectural, Civil & Structural Design Consultants

Date	JAN 09
Scale	1/50-A1 1/100-A3
Drawn	DS
Checked	

Drawing No.
2009/ A1 / HG / 106 rev A