

a1

design R ©

BEWARE OVERHEAD ELECTRIC CABLES SHROUD or ISOLATE FOR DURATION OF CONSTRUCTION WORK


PART RUN OF CABLE TAKEN UNDERGROUND OR RE ROUTED TO BE AGREED WITH NPG

contractor and client to refer to Electric Board for site safety check and also to refer to HSE guidance as noted below.

Working safely near overhead power lines Agricultural info sheet 8

Avoidance of danger from overhead electric power lines GS 6

Erect barriers to prevent close approach to cables as noted in GS 6

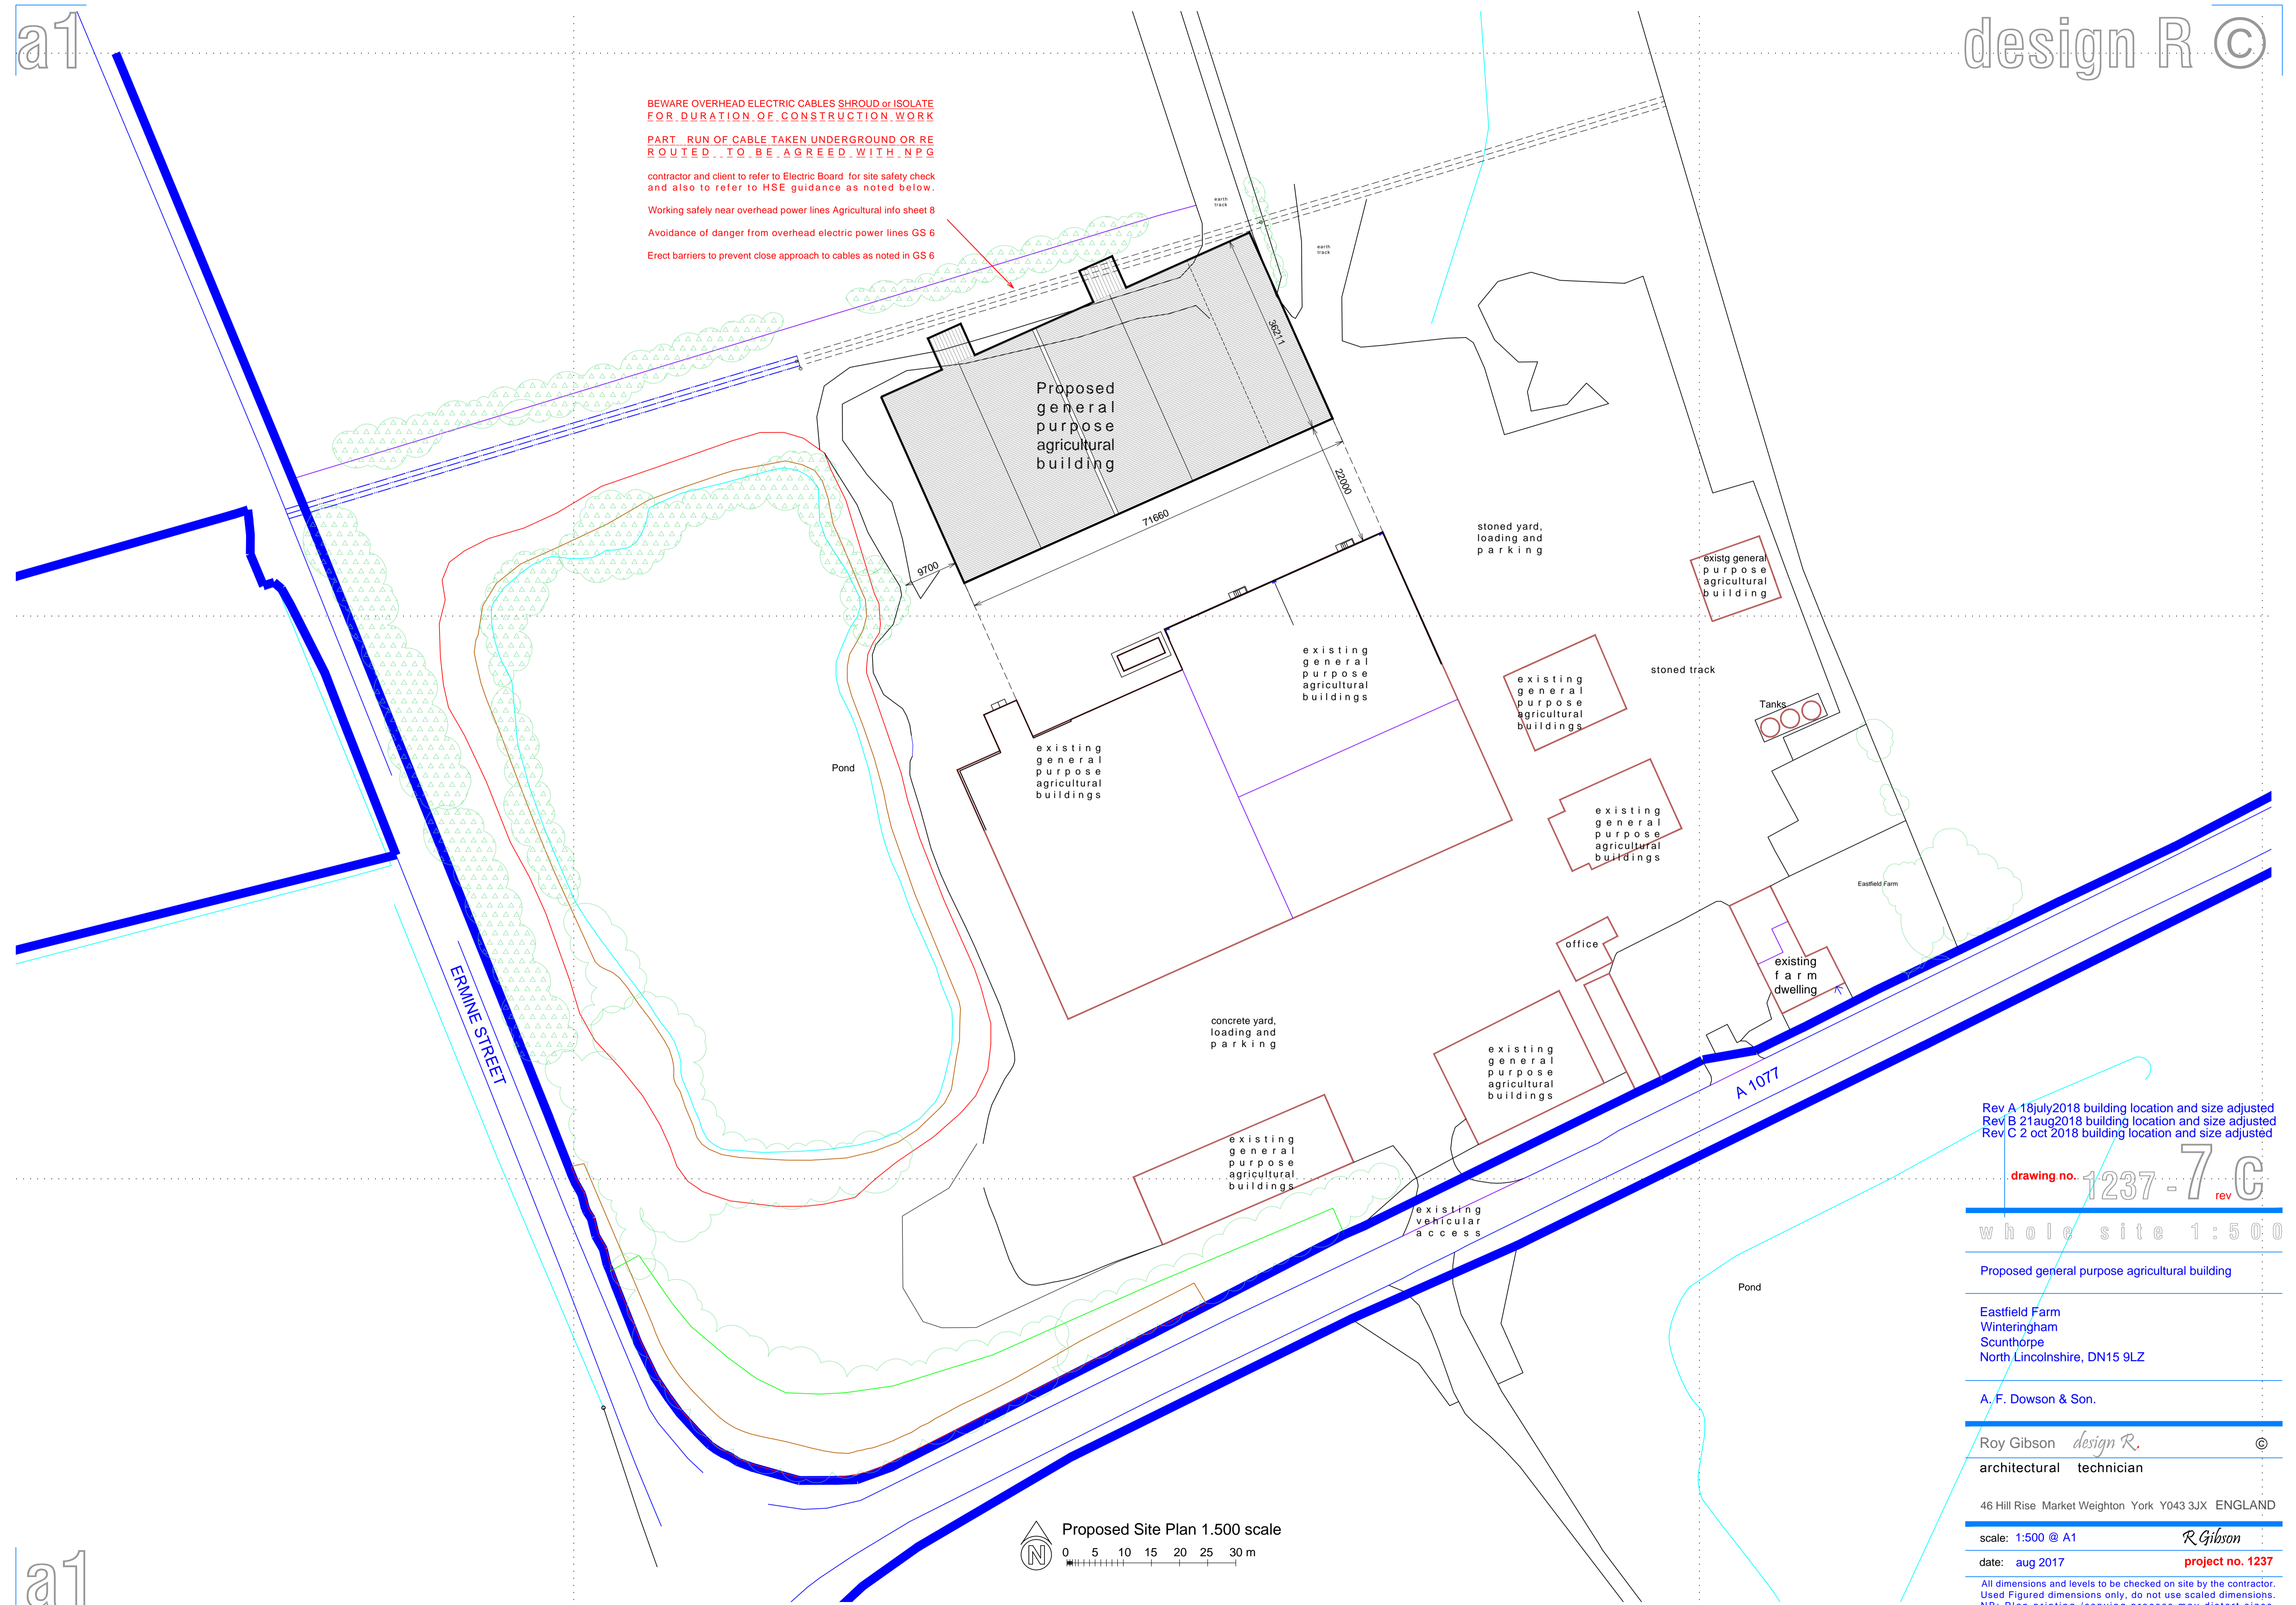

Rev A 18 July 2018 building location and size adjusted  
 Rev B 21 Aug 2018 building location and size adjusted  
 Rev C 2 Oct 2018 building location and size adjusted

drawing no. 1237-7 C rev

whole site 1:50:0

Proposed general purpose agricultural building

Eastfield Farm  
 Winteringham  
 Scunthorpe  
 North Lincolnshire, DN15 9LZ

A, F. Dowson & Son.


Roy Gibson *design R.* ©  
 architectural technician

46 Hill Rise Market Weighton York YO43 3JX ENGLAND

scale: 1:500 @ A1 *R Gibson*

date: aug 2017 project no. 1237

All dimensions and levels to be checked on site by the contractor.  
 Used Figured dimensions only, do not use scaled dimensions.  
 NB: Plan printing /copying process may distort sizes.

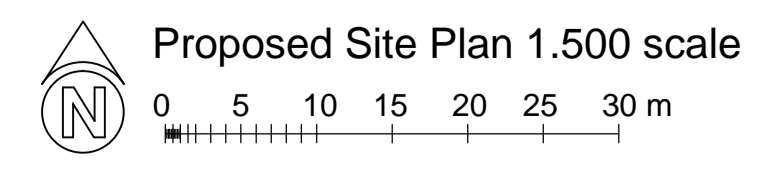

a1